

TRUCK OK
NOT STAKED

CAUTION
SEE HIDDEN HAZARD FORM
PRIOR TO DIGGING

REP 100W HPS COLONIAL
WITH TYPE H LED COLONIAL
ON EX. 12' BLACK POLE


1	46300-88277
8	46290-88177
12	46256-88181
14	47947-85335
19	33174-95240
21	46220-88223
25	46217-88186
27	46181-88189
30	46184-88220
31	46190-88243
32	32864-95260
33	46152-88244
37	46145-88193

INST TYPE H LED COLONIAL
ON 12' BLACK ALUM POLE

2	33734-95401
3	33921-95222
4	33856-94976
5	33892-94833
6	33828-94643
7	33807-94494
9	33996-94466
10	33686-94449
11	33575-94508
13	33488-94656
15	33517-94981
16	33532-95200
17	46265-88265
18	33232-95412
20	33203-95019
22	33180-94694
23	33168-94544
24	33314-94475
26	32950-94513
28	32806-94568
29	32818-94714
34	32476-94963
35	32412-94742
36	32448-94606
38	32384-94416
39	32601-94539

INST #12 2/C CABLE IN 1" DUCT

A	200'	4',12' BORES
B	136'	15',12' BORES
C	30'	25' BORE
D	203'	20',14' BORES
E	164'	14' BORE
F	146'	5' BORE
G	10'	
H	165'	25' BORE
I	162'	
J	120'	25',14' BORES
K	120'	33' BORE
L	200'	25',12' BORES
M	171'	17' BORE
N	173'	12',14',25' BORES
O	150'	
P	10'	
Q	148'	12' BORE
R	152'	21',13' BORES
S	41'	12' BORE
T	156'	18' BORE
U	143'	12',4' BORES
V	45'	25' BORE
W	89'	

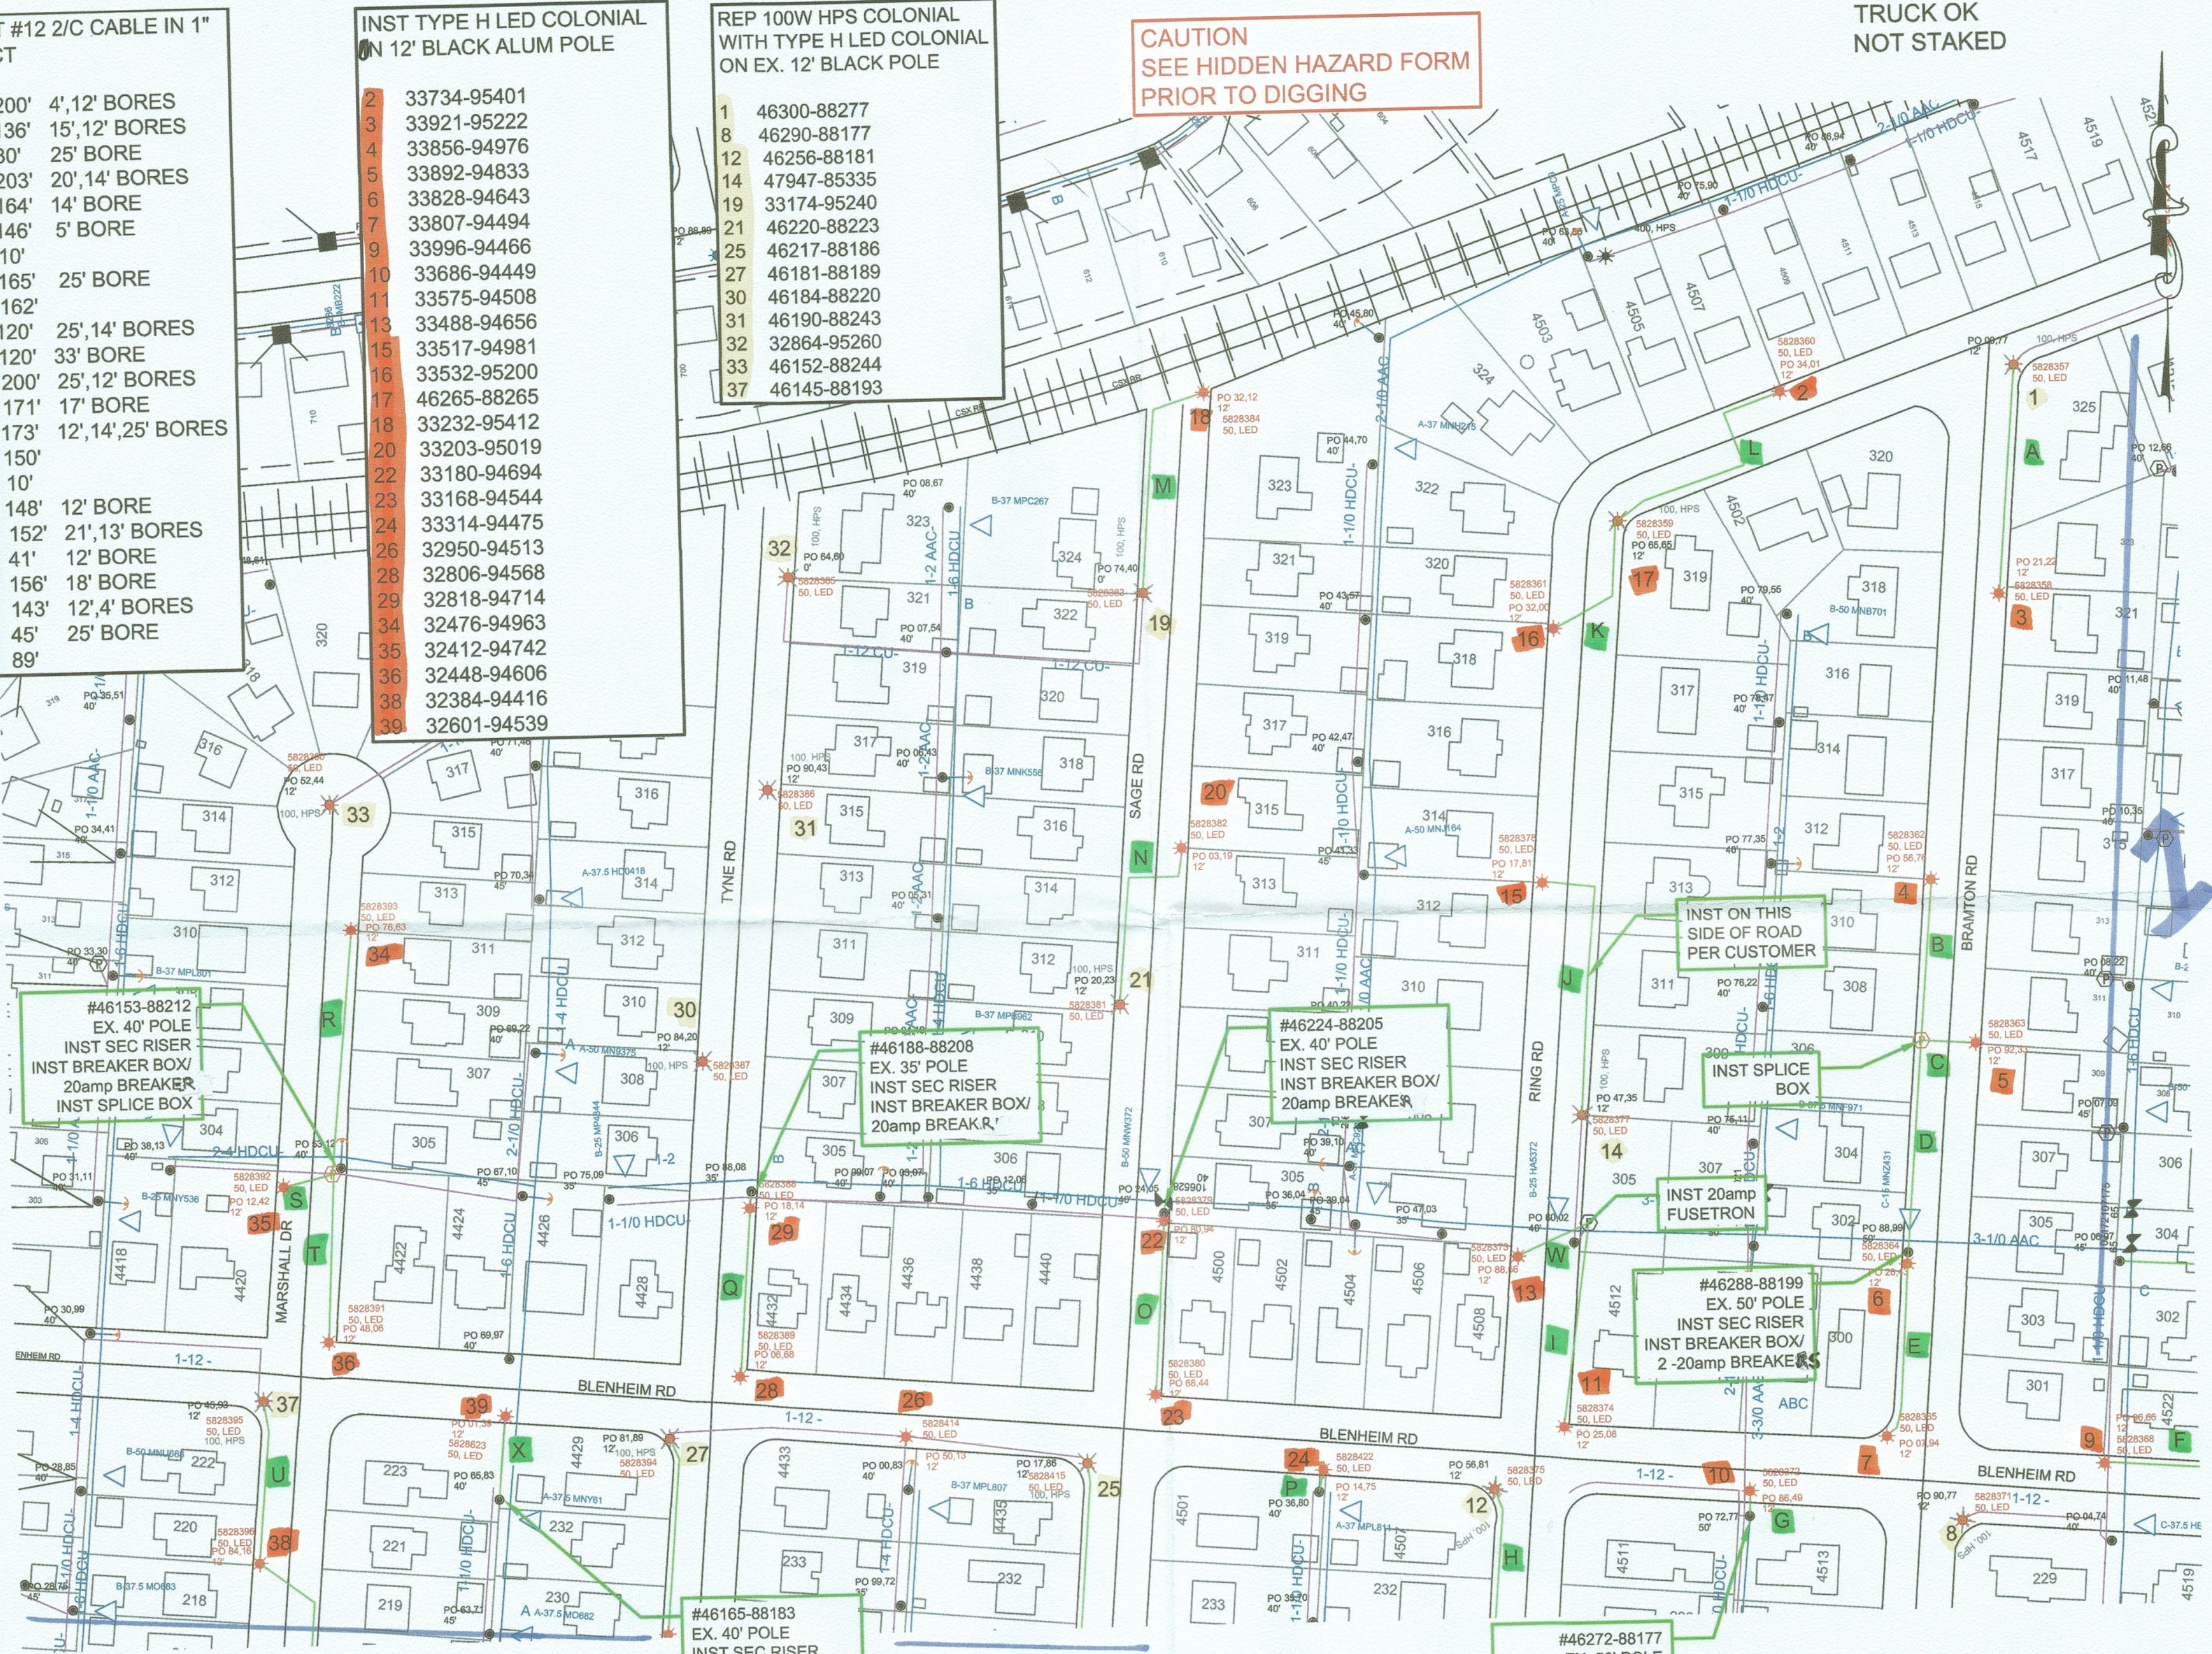

JOB BRIEFING

- HAZARDS ASSOCIATED-WITH THE JOB
- WORK PROCEDURES INVOLVED
- SPECIAL PRECAUTIONS
- ENERGY SOURCE CONTROLS
- PERSONAL PROTECTIVE EQUIPMENT REQUIRED

SIGNATURE _____

ATTENDEES _____

RETURN TO OUTDOOR LIGHTING DEPT
WORKMAN

DATE WORK COMPLETED

